



Cata Research
ADVANCING SCIENCE. ENSURING QUALITY.

CERTIFICATE OF ANALYSIS

Document Number:

COA-CR-BW-1026-01



PRODUCT NAME

Bacteriostatic Water



BATCH/LOT NUMBER

CR-BW-1026



PACK SIZE

10mL




DATE OF ANALYSIS


June 1, 2026

#	TEST	SPECIFICATION	RESULT	METHOD	STATUS
1.	Appearance	Clear, colorless, sterile solution, free from visible particulate matter	Conforms	Visual Inspection	✓ PASS
2.	pH	4.5 - 7.0	5.8	pH Meter	✓ PASS
3.	Benzyl Alcohol Content	0.9% - 1.1% (v/v)	0.99%	HPLC	✓ PASS
4.	Sterility	No growth after 14 days	No growth detected	Membrane Filtration (USP <71>)	✓ PASS
5.	Bacterial Endotoxins	<0.5 EU/mL	<0.05 EU/mL	LAL	✓ PASS
6.	Particulate Matter	≤25 particles/mL (≥10µm)	Conforms	Light Obscuration (USP <788>)	✓ PASS
7.	Osmolality	280 - 310 mOsm/kg	295 mOsm/kg	Freezing Point Depression	✓ PASS
8.	Water Content (Conductivity)	≤1.0 µS/cm	0.42 µS/cm	Conductivity Meter	✓ PASS
9.	Heavy Metals (Total by ICP-MS)	≤1.0 ppm	<0.1 ppm	ICP-MS	✓ PASS

BENZYL ALCOHOL ASSAY

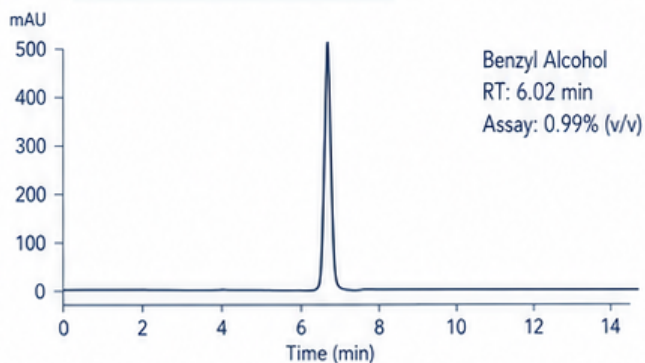

PH / CONDUCTIVITY PROFILE

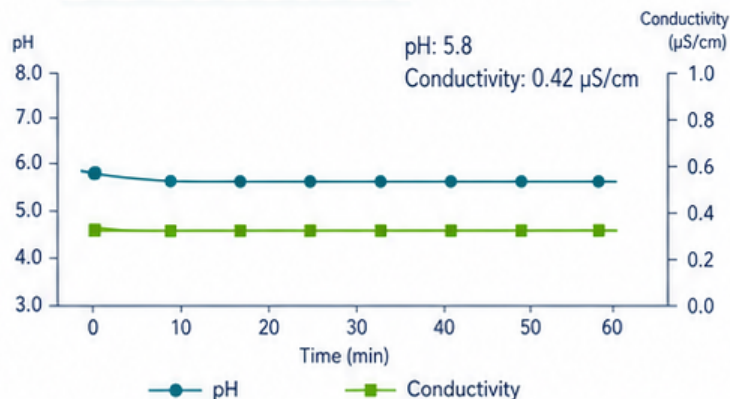

This product was tested by independent ISO-accredited laboratories located throughout North America. Full analytical data and sterility reports are available upon request.

QC Release Authorized By:

CResearch

Date: June 1, 2026